













Planta Baixa Pavimento Superior.
Escala 1/75

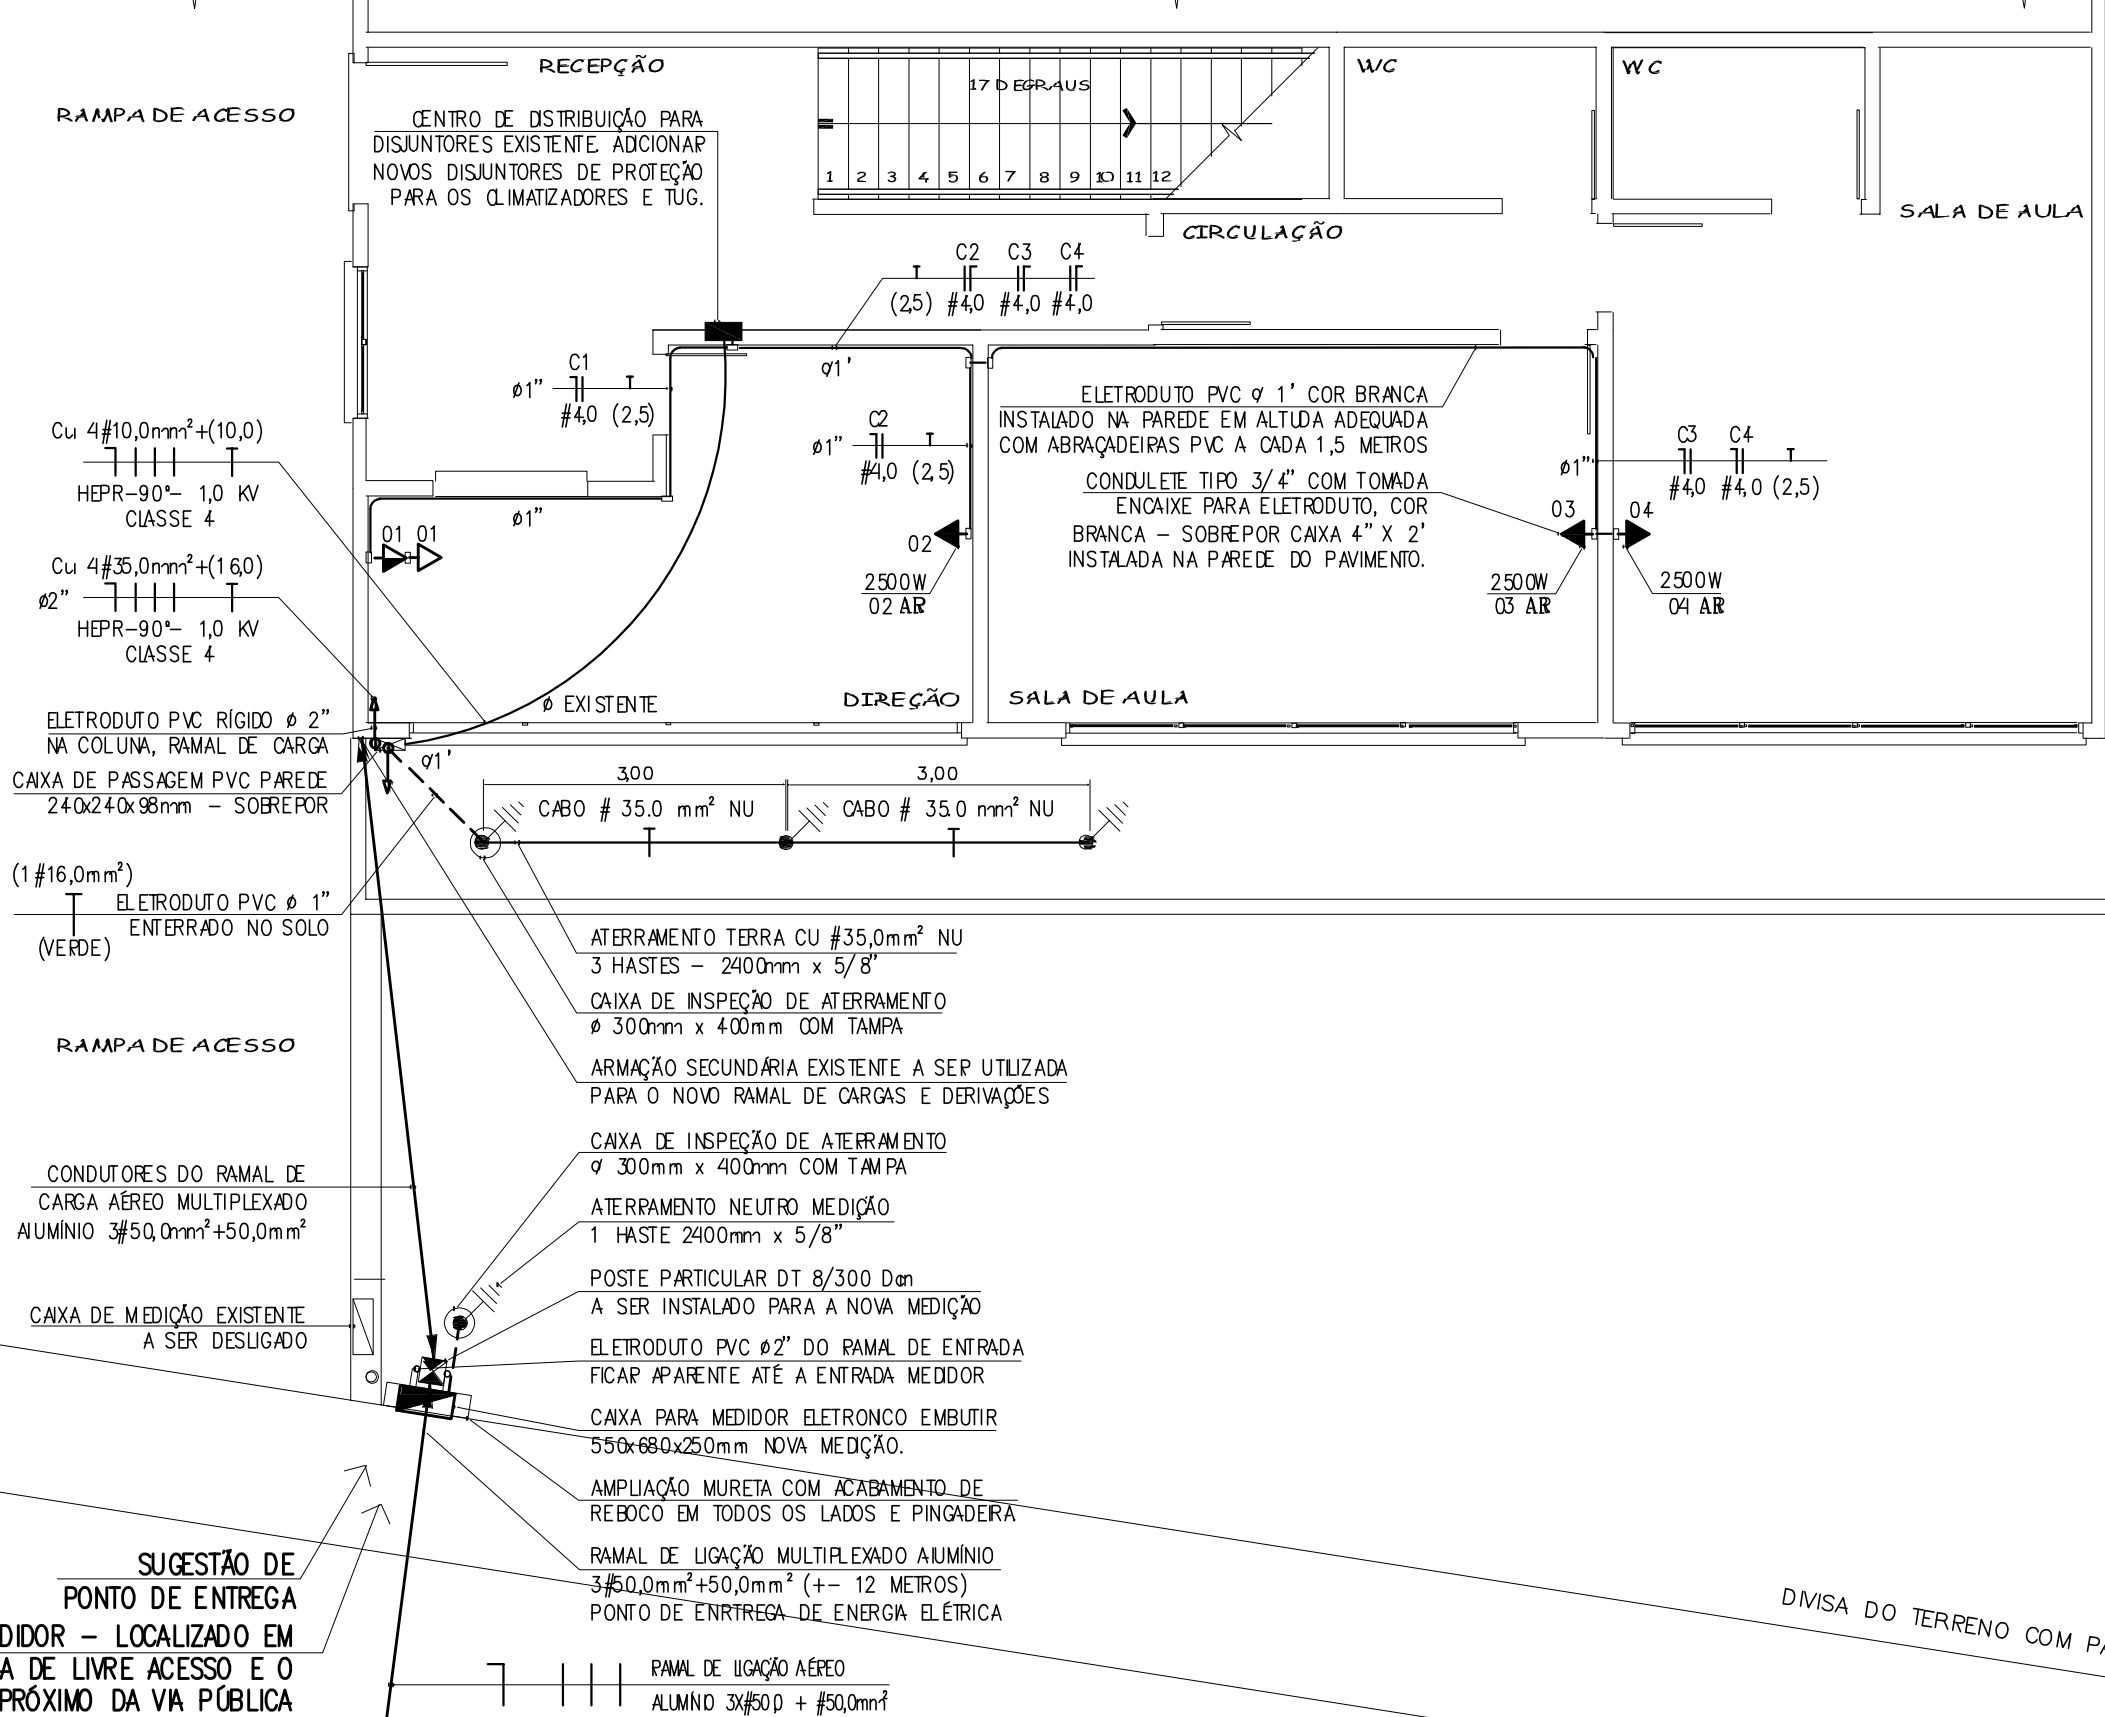

Planta Baixa 1º Pavimento.
Escala 1/75

Diagrama Medição

Sem Escala

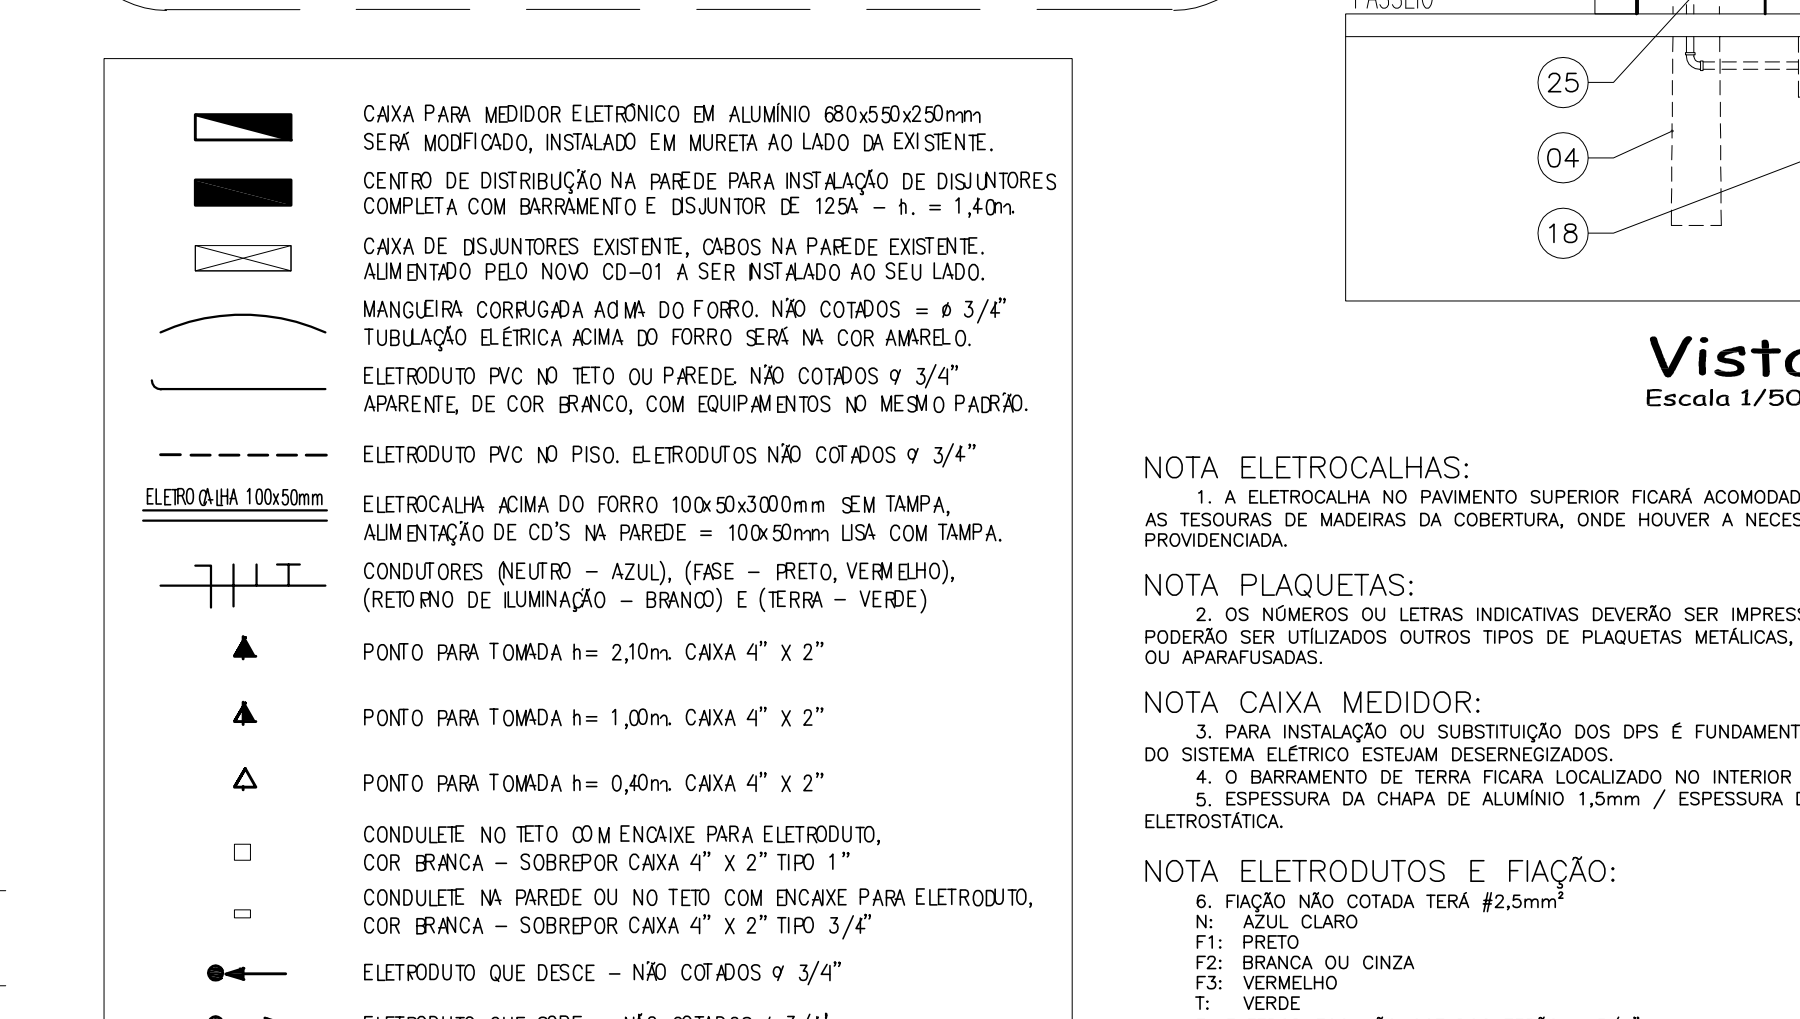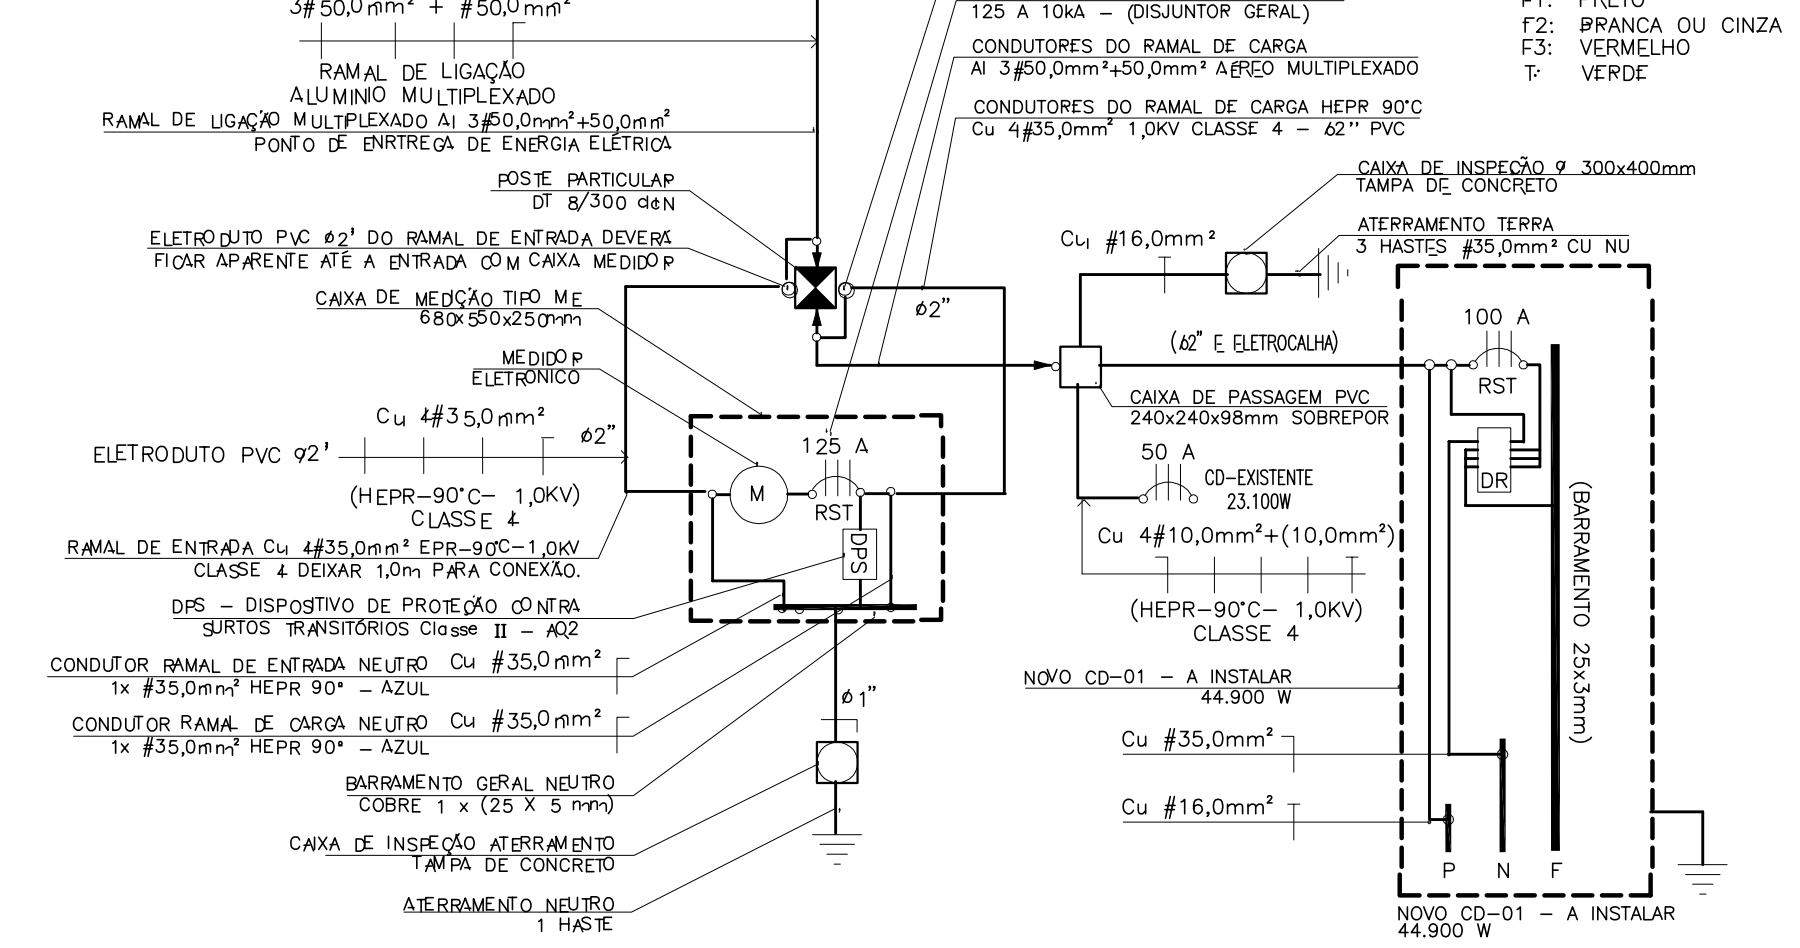

Vista Lateral Mureta de Medição
Escala 1/50

Quadro de Carga Novo CD-01

C.D.	CIRCUITO	ILUMINAÇÃO (W)										TOMADAS (V)						MOTORES CV	CARGA W	BITOLA # mm²	PROTEÇÃO Δ	FASE R S T
		5	8	10	25	100	100	600	1000	2500	3000	6000	10000									
Novo CD=01 (Pav. Superior)	C1							1										600	4,0	25	R	
	C2							1										600	4,0	25	S	
	C3							1										600	4,0	25	T	
	C4							1										600	4,0	25	R	
	C5								1									2500	4,0	25	S	
	C6								1									2500	4,0	25	T	
	C7								1									2500	4,0	25	R	
	C8								1									2500	4,0	25	S	
	C9								1									2500	4,0	25	T	
	C10 EXIST.										1							6000	EXISTENTE			
	C11 EXIST.											1						6000	EXISTENTE			
	C12 EXIST.												1					6000	EXISTENTE			
	C13 EXIST.													1				3000	EXISTENTE			
	C14 EXIST.														1			3000	EXISTENTE			
	C15 EXIST.															1		3000	EXISTENTE			
	C16 EXIST.																1	3000	EXISTENTE			
	TOTAL									4	5	4	3					44.900W	35,0	100	A	RST
CD=Existente (Pav. Inferior)	C1							1										600	4,0	25	R	
	C2								1									2500	4,0	25	S	
	C3								1									2500	4,0	25	T	
	C4								1									2500	4,0	25	R	
	C5 EXIST.												1					6000	EXISTENTE			
	C6 EXIST.													1				6000	EXISTENTE			
	C7 EXIST.														1			3000	EXISTENTE			
	C8 EXIST.																	3000	EXISTENTE			
	TOTAL									1	3	1	2					23.100W	10,0	50	A	RST
SOMA TOTAL										5	8	5	5				68.000W	35,0	125	A	RST	

Diagrama Novo CD-01

Sem Escala

